




**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss


DHP-AQ 6



**A+**

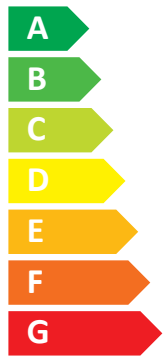

**B**



2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 6





55 °C

35 °C



**A+**

**A+**

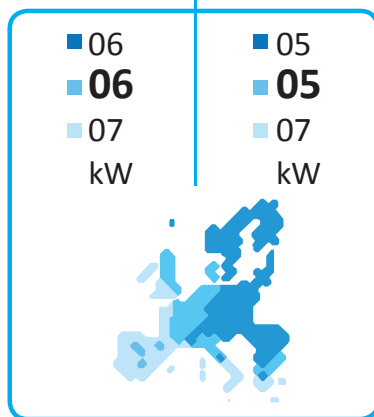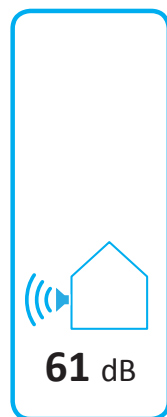

2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 6



+



+



+



+



**A+**



**A**


2015

811/2013


Danfoss DHP-AQ 9



A++

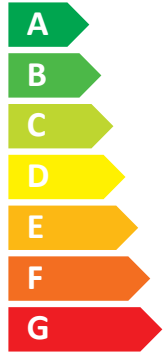

A



Danfoss DHP-AQ 9





55 °C

35 °C



A++

A+

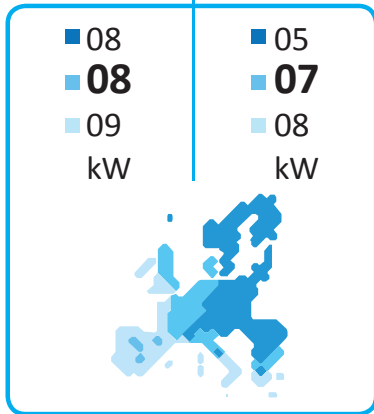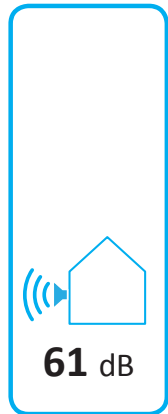


Danfoss DHP-AQ 9

+


+

+

+

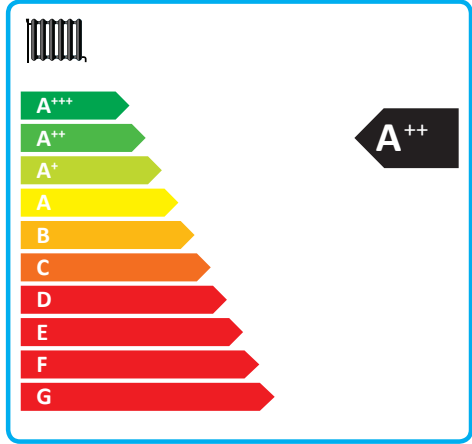


A++


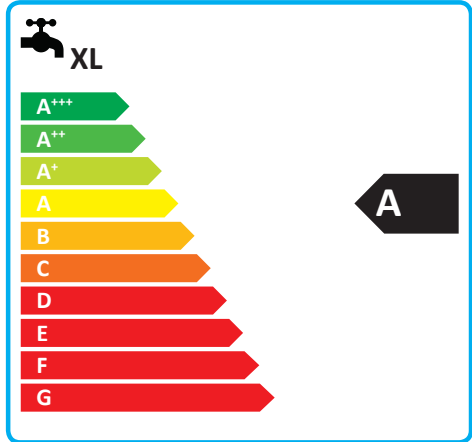


A


Danfoss DHP-AQ 11

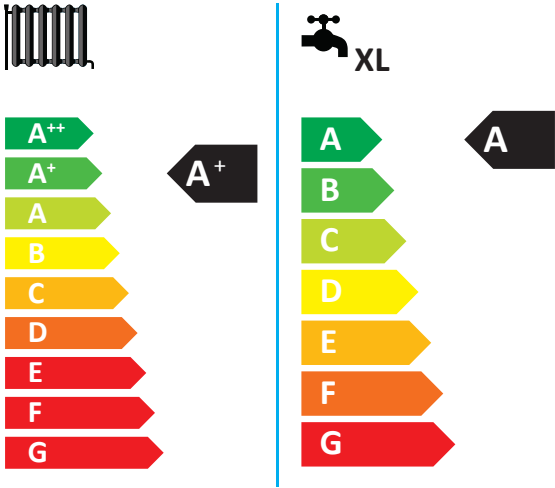

Danfoss DHP-AQ 11

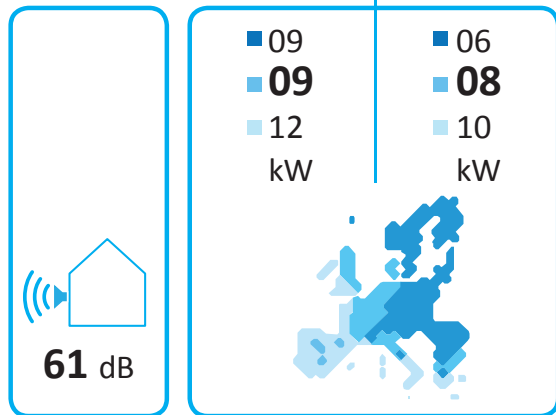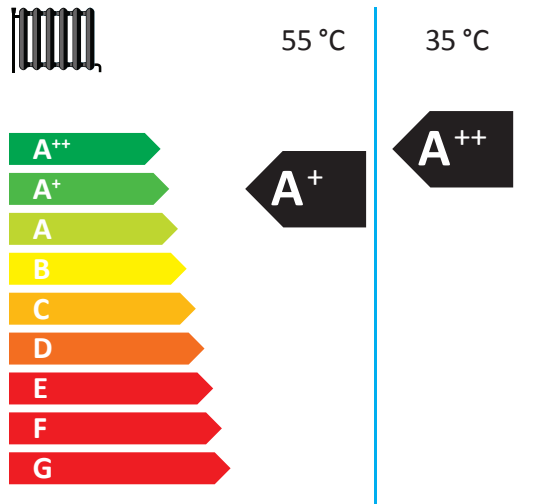

Danfoss DHP-AQ 11

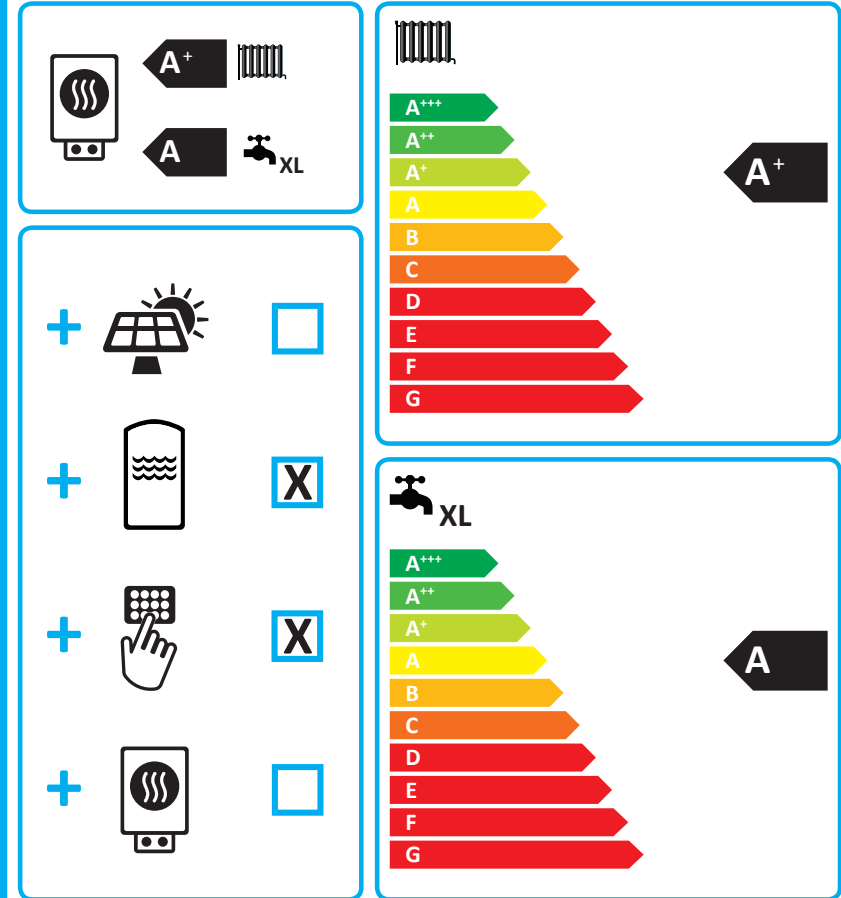




**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss


DHP-AQ 13



**A++**

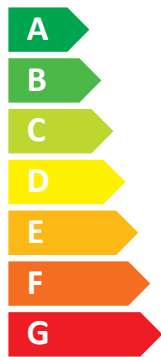

**A**



2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 13




55 °C

35 °C



**A++**

**A+**

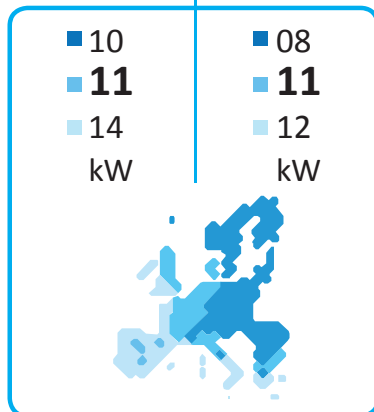

2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 13

A++  
A

+   
+   
+   
+

A+++  
A++  
A+  
A  
B  
C  
D  
E  
F  
G

**A++**


A+++  
A++  
A+  
A  
B  
C  
D  
E  
F  
G

**A**



2015

811/2013





Danfoss DHP-AQ 16

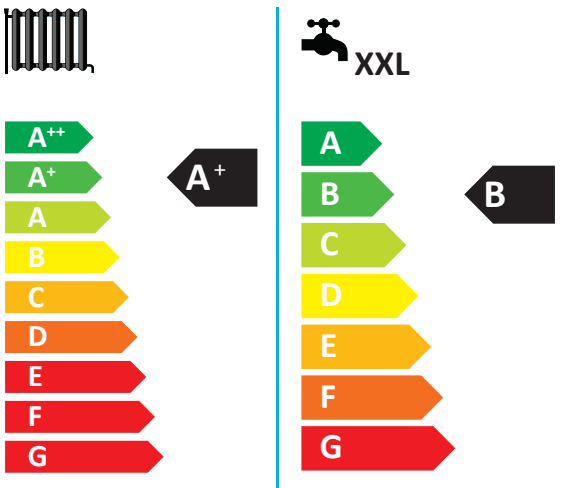

Danfoss DHP-AQ 16

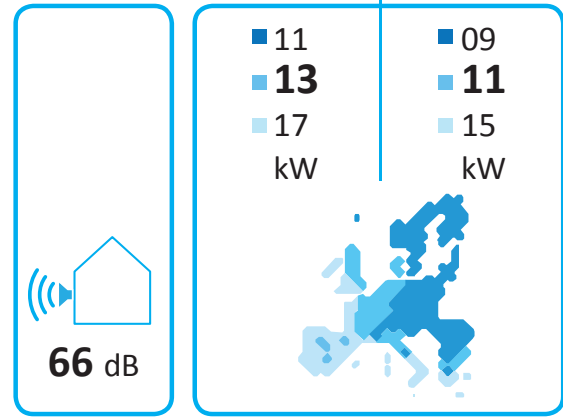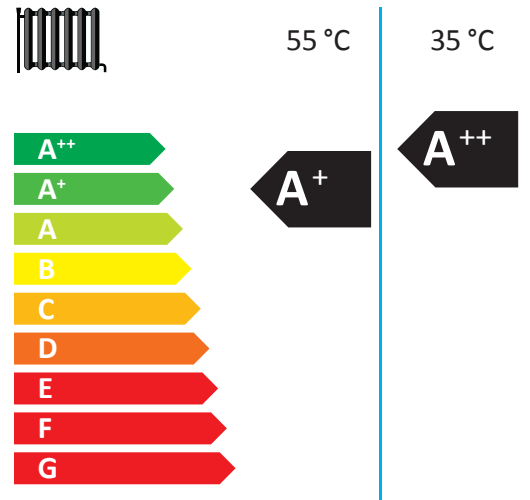

Danfoss DHP-AQ 16

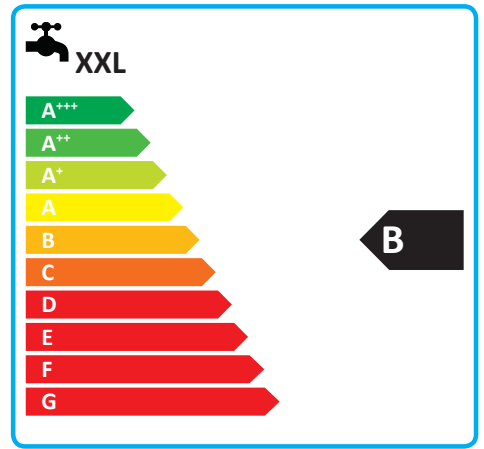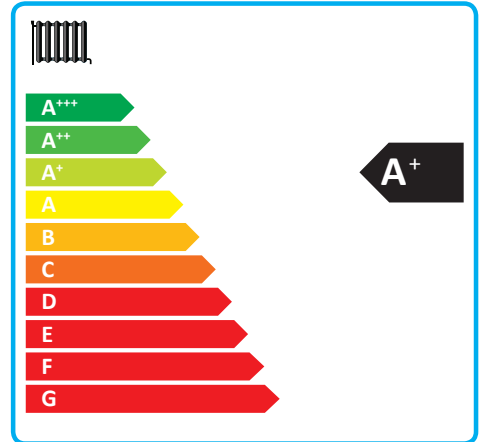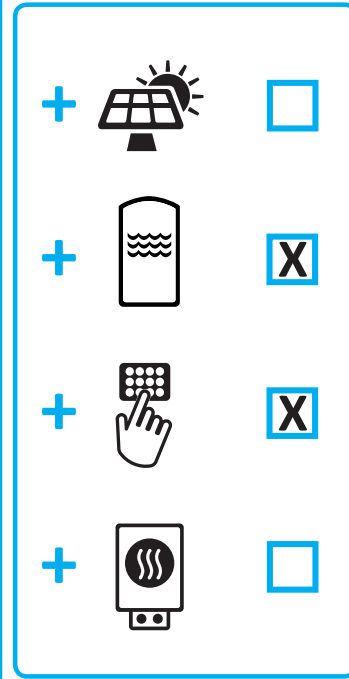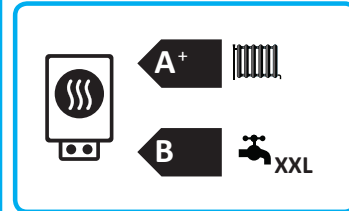




**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss


DHP-AQ 18



A+

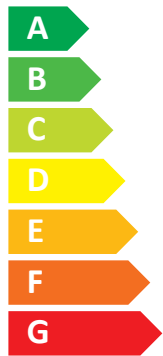

B



2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 18




55 °C

35 °C



A+

A+

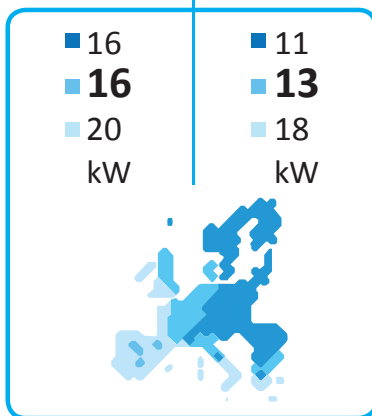

2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 18



A+



B



+



□

+



X

+



X

+



□



A+




B


2015

811/2013


Danfoss DHP-AQ 6 SP

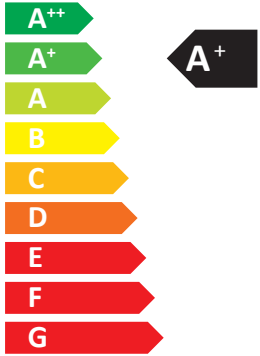

A+

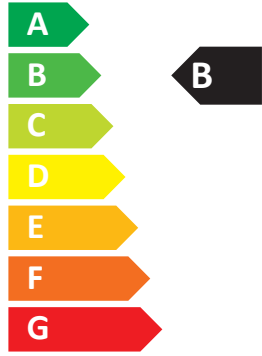

B



Danfoss DHP-AQ 6 SP




55 °C

35 °C



A+

A+

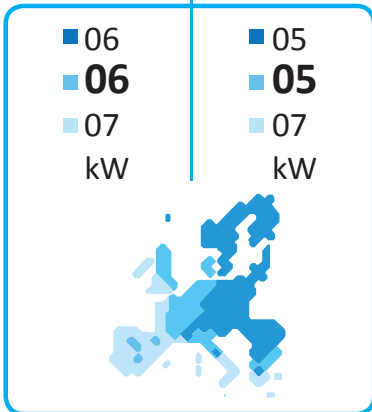

Danfoss DHP-AQ 6 SP




A+

B



A+

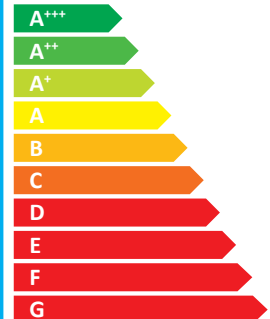


B



Danfoss DHP-AQ 9 SP



A++

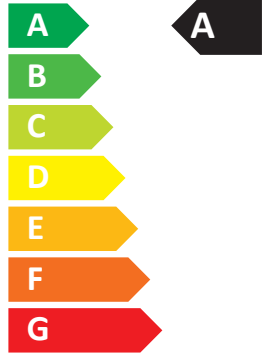

A



Danfoss DHP-AQ 9 SP





55 °C

35 °C






A++


A+

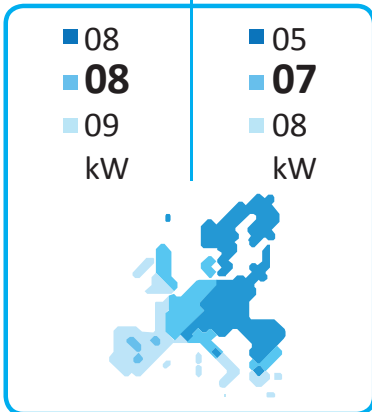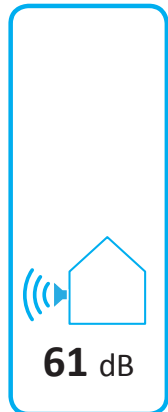

Danfoss DHP-AQ 9 SP

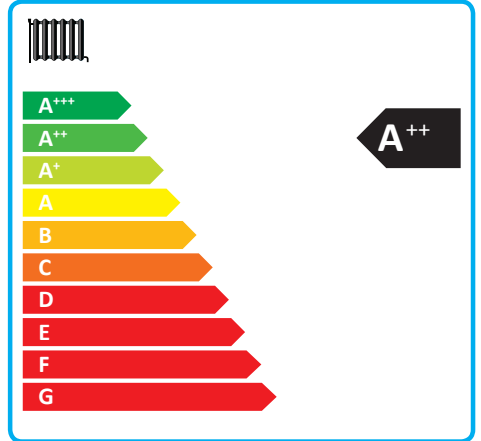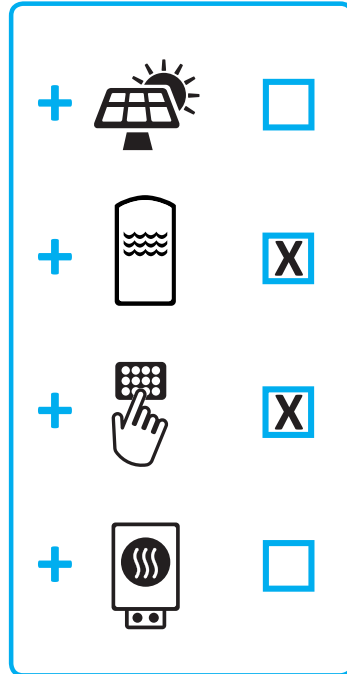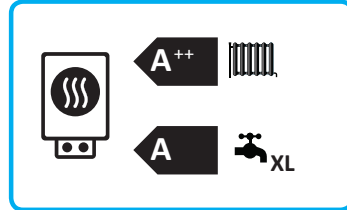

A++

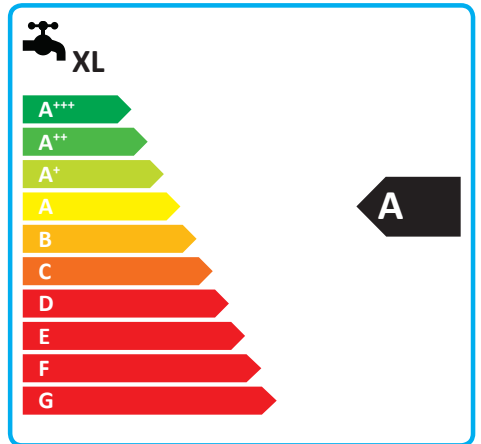

A






**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss



DHP-AQ 11 SP



A+

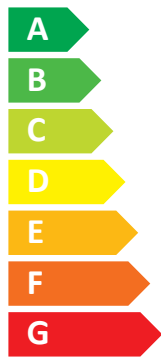

A



2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 11 SP





55 °C

35 °C



A+

A++

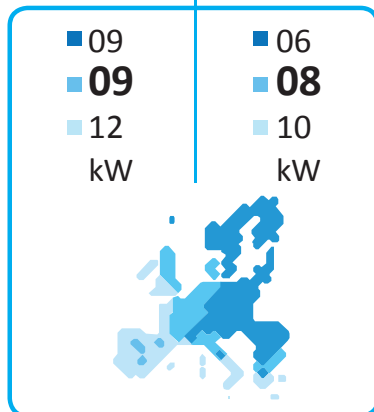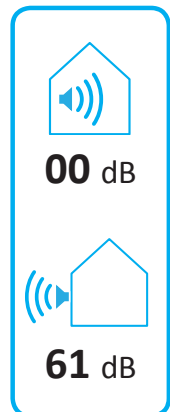

2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 11 SP



A+  
A

+



□

+



X

+



X

+



□



A+



A

2015


811/2013

Danfoss



DHP-AQ 13 SP



A++

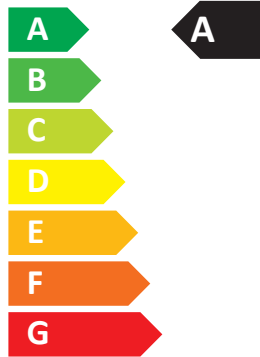

A



2015

811/2013

Danfoss

DHP-AQ 13 SP




55 °C

35 °C



A++

A+

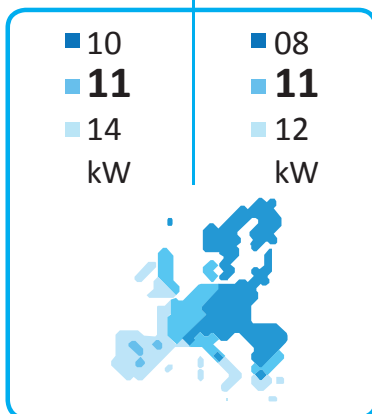


2015

811/2013



Danfoss

DHP-AQ 13 SP

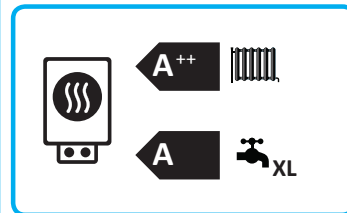


A++

A

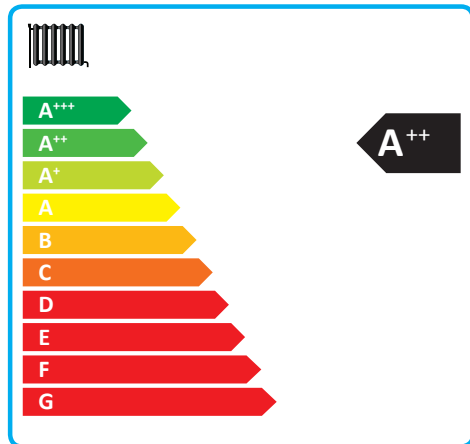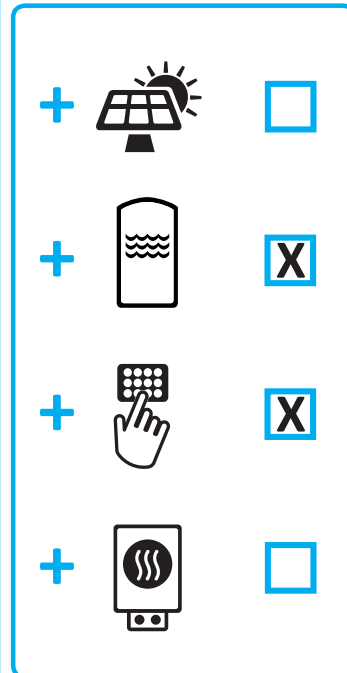

A++

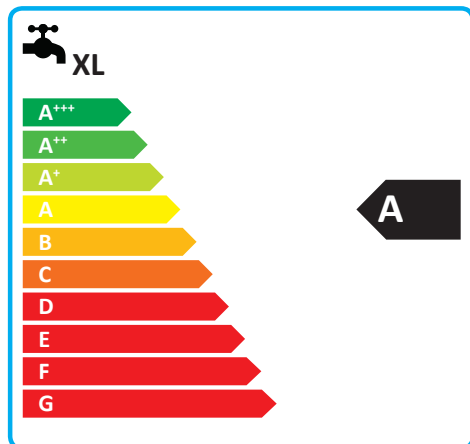

A

2015

811/2013




**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 16 SP



**A+**

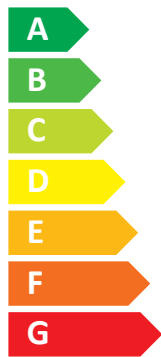

**B**



66 dB



2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 16 SP




55 °C

35 °C



**A+**

**A++**



66 dB



2015

811/2013



**ENERG** Y IJA  
енергия · ενεργεια IE IA

Danfoss

DHP-AQ 16 SP



**A+**



**B**



+



+



+



+



**A+**



**B**

2015

811/2013